

ENERGY BUILDING CERTIFICATION IN PRACTICE

Daniel Hlubeň, Ľubomír Beňa, Jozef Balogh

ABSTRACT

This paper entitled “Energy building certification in practice” deals with the new standard EN 15 193 and software support to ease building assessment.

1 INTRODUCTION

According to the aim of European Union to improve efficiency of electric energy consumption in buildings, several standards were published during last year. [1]

The main goal of these standards is to assess energy consumption. Buildings assessed according to this methodology are divided into several groups (A, B, ..., G), according to the efficiency of the whole building. This assessment includes several fields and the lighting is one of these fields.

But, from the point of view of users, the usage of this standard is a bit complicated and the software support is necessary.

2 ENERGY PERFORMANCE FOR LIGHTING

The main goal of this standard is to establish conventions and procedures for the estimation of the energy requirements of lighting in buildings and also give a methodology for a numeric indicator of energy performance of building. [2]

At the beginning, it is necessary to write, that there are several methods, how to assess energy performance:

- Quick method
- Comprehensive method
- Measurement of lighting circuit

The comprehensive method is used for building certification. In this article we would like to show, how to use energy assessment in the field of energy consumption of lighting.

2.1 Example

In this example the classroom is room calculated according the standard.

Room


- Height = 2,6 m
- Width = 7,5 m
- Depth = 4,5 m
- Work plane - height 0,8 m

Windows, double glazed (standard values acc. to the EN)

- Height 2 m
- Width 1,5 m
- Height above a floor 0,8 m

Lights

- 6 x Philips Fines TCS 198 2xTL-D36W/840 HF C6 ($P_1 = 72$ W)

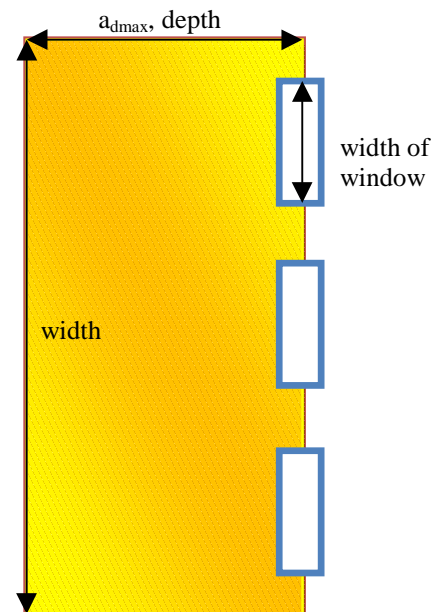

Maintenance factor 0,8.

Maintained illuminance according to the EN 12 464 [3], 500 lx.

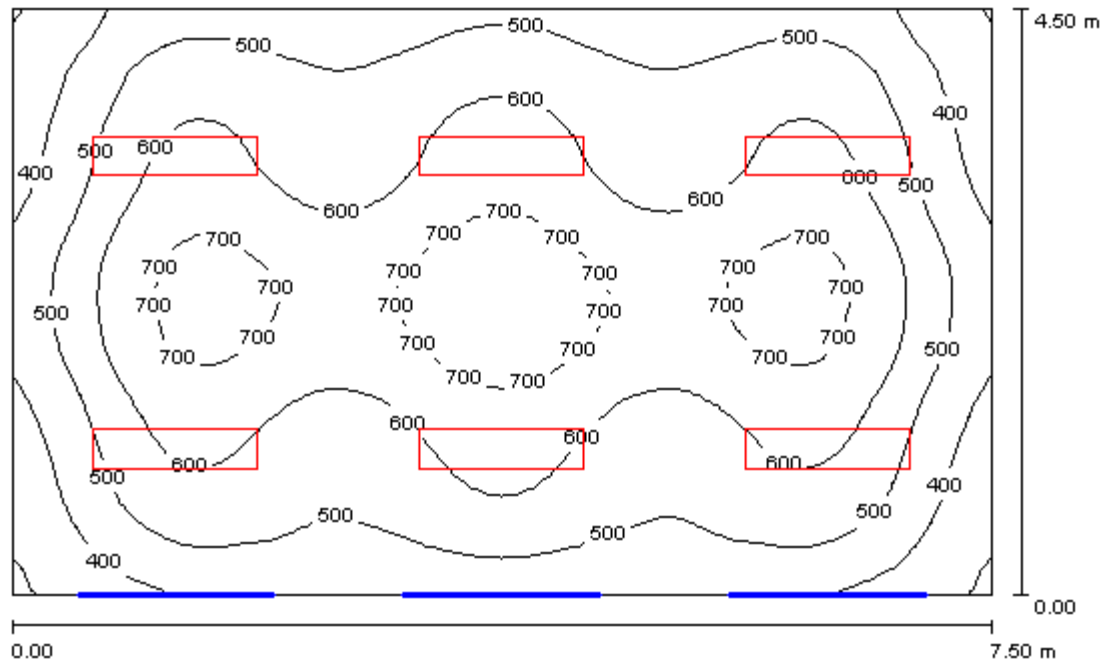


Fig. 1 Illumination of the classroom (example)

Surface	ρ [%]	E_{av} [lx]	E_{min} [lx]	E_{max} [lx]	u_0
Workplane	/	559	285	763	0.51
Floor	20	485	277	677	0.57
Ceiling	70	88	62	102	0.71
Walls (4)	50	189	57	369	/

Fig. 2 Result of the illumination

2.2 Comprehensive method –

2.2.1 Total useful floor area of the building

$$A = a \cdot b = 7,5 \text{ m} \cdot 4,5 \text{ m} = 33,75 \text{ m}^2$$

2.2.2 Area of carcass openings:

$$A_c = 9 \text{ m}^2.$$

2.2.3 The maximum possible depth of zone

$$a_{Dmax} = 2,5 \cdot (2,8 - 0,8) = 2,5 \cdot 2 = 5, \text{ but depth of the room is } 4,5 \text{ m. } a_{Dmax} = 4,5 \text{ m.}$$

2.2.4 Daylight space

$$A_D = 33,75 \text{ m}^2.$$

2.2.5 Transparency index

$$I_T = A_c / A_D = 9 / 33,75 = 0,266 [-]$$

2.2.6 Depth Index

$$I_{De} = 4,5 / 2 = 2,25 [-]$$

2.2.7 Obstructions

2.2.7.1 The correction factor for linear obstructions

$$I_{OOB} = \cos(1,5 \cdot 30) = 0,707 [-]$$

2.2.7.2 The correction factor overhang

$$I_{OOV} = \cos(1,33 \cdot 30) = 0,767 [-]$$

2.2.7.3 The correction factor for vertical fins

$$I_{OVF} = 1 - 30/300 = 1 - 0,1 = 0,9 [-]$$

2.2.7.4 The correction factor courtyard and atria;

$$I_{OCA} = 1 [-]$$

2.2.7.5 The correction factor for glazed double façades

$$I_{OGDF} = 1 [-]$$

$$I_o = I_{OOB} \cdot I_{OOV} \cdot I_{OVF} \cdot I_{OCA} \cdot I_{OGDF} = 0,488 [-]$$

2.2.8 Daylight factor

$$D_c = (4,13 + 20 \cdot 0,266 - 1,36 \cdot 2,25) \cdot 0,488 = 3,125 [%]$$

2.2.9 Daylight factor classification

$$D = D_c \cdot \tau_{D65} \cdot k_1 \cdot k_2 \cdot k_3 = 3,125 \cdot 0,82 \cdot 0,78 \cdot 0,8 \cdot 0,73 = 1,167 [%] = \text{WEAK}$$

2.2.10 Daylight supply factor (for 500 lx)

$$F_{D,S} = a + b \cdot \gamma_{\text{site}} = 0,9432 - 0,0094 \cdot 48,70666666666667 = 0,484793$$

2.2.11 Detailed determination of F_o

$F_{OC} = 1$ – the lighting is switched on centrally

2.2.11.1 Absence factor

$F_A = 0,25$ – classroom

According to the equation (D.4), $F_o = F_{OC} + 0,2 - F_A = 0,95 [-]$

2.2.11.2 Daylight dependent artificial lighting control

F_{DC} according to the table C.9 for manual control and daylight penetration (WEAK) equals 0,2.

2.2.11.3 Daylight dependency factor

$$F_D = 1 - F_{D,S} \cdot F_{D,C} = 1 - 0,484 \cdot 0,2 = 0,9029 [-]$$

2.2.12 LENI INDEX CALCULATION

$$W_{Lit} = ((P_n \cdot F_c) \cdot ((t_D \cdot F_o \cdot F_D) + (t_N \cdot F_o))) / 1000 = ((6.72.1) \cdot ((1800 \cdot 0,95 \cdot 0,9029) + (200 \cdot 0,95))) / 1000 = 749,070 \text{ kWh}$$

$$\text{LENI} = W/A = 749,070 / 33,75 = 22,195 \text{ kWh/m}^2 \cdot \text{year}$$

$$\text{LENI} = 23 \text{ kWh/m}^2 \cdot \text{rok}$$

3 CONCLUSION

This article briefly describes process of LENI index calculation. It is necessary to write, that in this standard some combinations are not solved and the standard is too complicated. The main goal of the standard is the effort to influence prices, but if there is lack of competitive buildings, the assessment has no influence on the prices of buildings and energy consumption. It can be said, that energy building certification has no effect on prices and it is a new excess of the European Union without any effective consequences on the over-consumption.

4 REFERENCES

- [1] DIRECTIVE 2006/32/EC OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 5 April 2006 on energy end-use efficiency and energy services and repealing Council Directive 93/76/EEC
- [2] EN 15193: Energy performance of buildings — Energy requirements for lighting
- [3] EN 12464-1, Light and Lighting – lighting of workplaces – Part 1: Indoor work places
- [4] MIHALÍKOVÁ, Jana: Problém výberu simulačného nástroja pre simulačný projekt. In: Novus scientia 2007: 10. celoštátna konferencia doktorandov strojnícckých fakúlt technických univerzít a vysokých škôl s medzinárodnou účasťou: 20.11.2007 ÚVZ Herľany, Slovenská republika. Košice : TU, 2007. s. 392-396. ISBN 978-80-8073-922-5.

Author address:

Ing. Daniel Hlubeň
Department of Electric Power Engineering
Technical University of Košice
Mäsiarska 74
040 01 Košice, Slovak Republic
E-mail: daniel.hluben@tuke.sk
Tel: +421 / 55 / 602 3559
Fax: +421 / 55 / 602 3552

Ing. Lubomír Beňa
Department of Electric Power Engineering
Technical University of Košice
Mäsiarska 74
040 01 Košice, Slovak Republic
E-mail: lubomir.bena@tuke.sk
Tel: +421 / 55 / 602 3561
Fax: +421 / 55 / 602 3552

Ing. Jozef Balogh, PhD.
Department of Electric Power Engineering
Technical University of Košice
Mäsiarska 74
040 01 Košice, Slovak Republic
E-mail: jozef.balogh@tuke.sk
Tel: +421 / 55 / 602 3564
Fax: +421 / 55 / 602 3552

This work was supported by Scientific Grant Agency of the Ministry of Education of Slovak Republic and the Slovak Academy of Sciences under the project VEGA No. 1/4072/07.

This work was supported by the Slovak Research and Development Agency under the contract No. APVV-0385-07.